
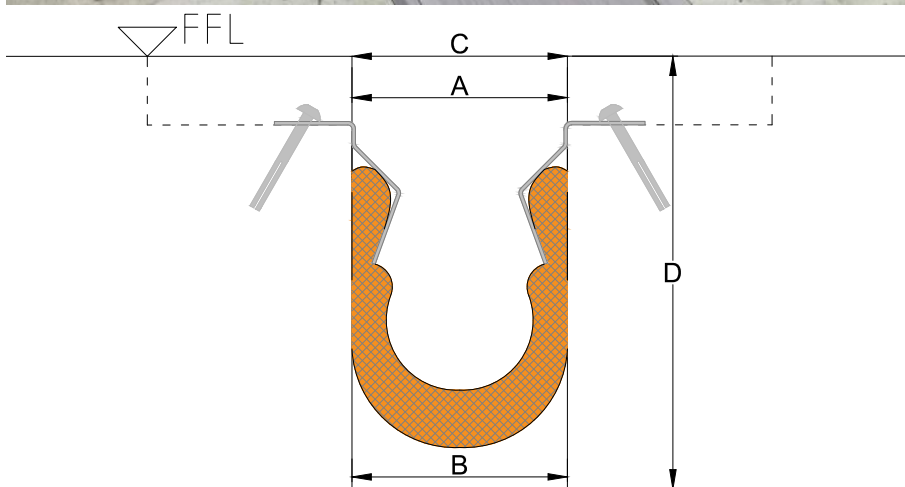
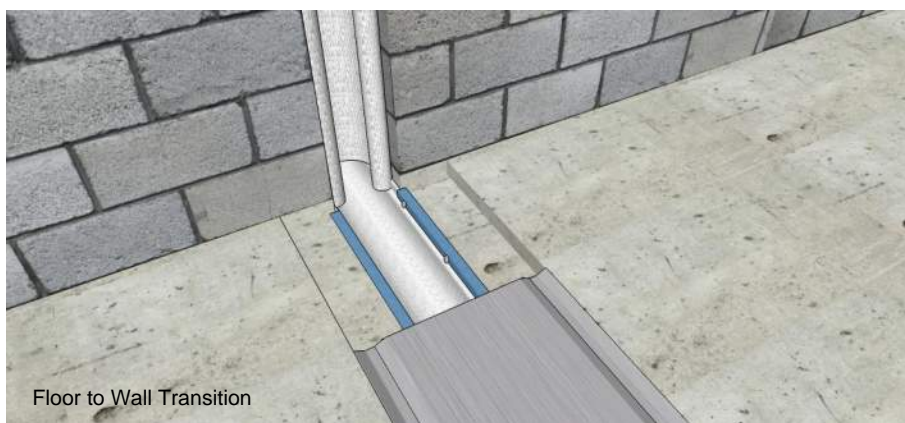


# Pyrotx B Fire Blankets for EJs

**Pyrotx B:** Designed to accommodate seismic activity, PyB is a very high movement fire-blanket system. The PyB is tested/certified to Australian and British standards for gaps of 250mm.... with movement well in excess of this. PyB can be used in masonry walls and floors, and can be applied in conjunction with a range of Unison coverplate systems.

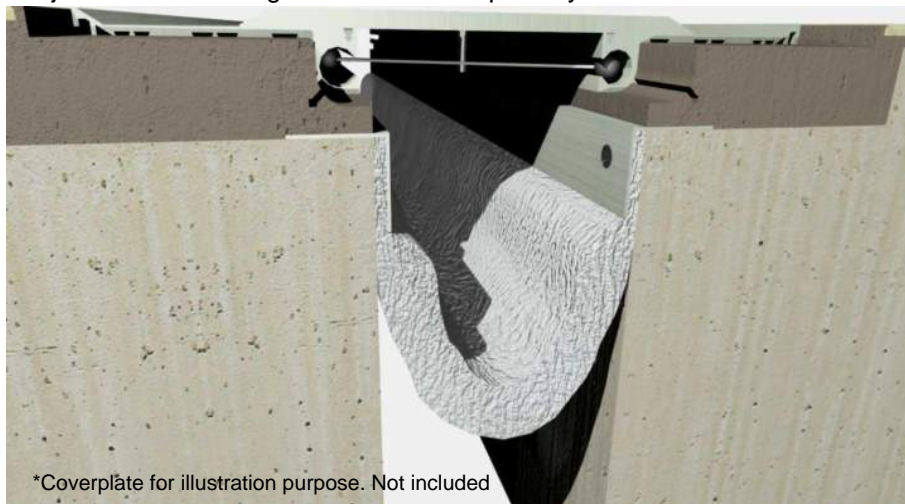

## Py B

Previous Model No: UFB



### Performance

- Expansion Joint Fireseal
- High fire resistance
- High movement capacity
- Certified to 250mm gaps
- Floor application
- Wall system seals both sides
- Compatible with coverplates & water seals

Tested and comply with:  
AS 1530.4  
AS 4072.1  
BS 476.20

### Standard Length

7.2m

This document remains Unison  
Joists Pty. Ltd.'s property.  
COMMERCIAL IN CONFIDENCE

EXOVA  
Engineering

Testing, Auditing, Assessing

EWA CERTIFICATE OF ASSESSMENT		CERTIFICATE No: SFC 27465-01		Page 1 of 1
Report Sponsor	Certificate Issue Date	Product Name		
Unison Joists Pty Ltd 130A Engleston Road Waverley QLD 4104	19/07/2016	25mm FIREMASTER Blanket Control Joint		
Assessment Reference	Reference Standard	Report Issue Date	Report Validity Date	
EWA 27465-01	AS 1530.4-2005	20/07/2016	31/07/2017	
<b>Introduction</b>				
The element of construction described below was assessed by the Laboratory on behalf of the report sponsor in accordance with the stated test standard and approved the results stated below. Refer to the referenced test reports or Regulatory Information Reports for a complete description of the assessed construction.				
<b>Assessed Control Joint description and performance</b>				
Control Joint	Orientation of Joint	Support Element	Opening Width	Direction of Exposure
A FIREMASTER Blanket 25mm thick	Horizontally or vertically	Concrete or Masonry Wall	70mm to 100mm wide 100mm to 250mm wide	Fire from either side
				FFL
				>240/120
Refer the referenced report for a complete description of the assessed construction.				
<b>Continuity/Variety</b>				
THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE.				
<ul style="list-style-type: none"> <li>Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the construction and justification for the conditions given, along with the validity statements, are given in the assessment reports.</li> <li>The assessment report or sheet form assessment report does not provide an endorsement by Exova Warringtonville Australia Pty Ltd of the actual products supplied. It is intended to provide a brief outline of the above referenced assessment reports and not to replace them.</li> <li>The conditions in this certificate or assessment sheet to the configurations as detailed, and should not be applied to any other configuration. The conditions expressed in this document assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of the hazard under all conditions.</li> <li>Full copies of the assessment and relevant test reports may be obtained from the sponsor.</li> </ul>				
<b>TESTING AUTHORITY</b>		Exova Warringtonville Ass Pty Ltd		
Address		Suite 100/101, Level 11, 111 Sharnford Street, Sydney NSW 2000, Australia		
Phone / Fax		tel: (02) 9270 7000 / tel: (02) 9299 8076		
E-mail		E: info@exova.com.au		
Email: Moses Pope		Prepared By:	Reviewed By:	
Authorisation:		M. Pope	D. Nicholson	

Product	A: Seal		B: Gap				C: Installation Width
	Width	Thick	Min.	Mid.	Max.	Mvmt.	
Py25/300B	300	25	50	113	175	125	70
Py25/400B	400	25	50	163	275	225	70
Py25/600B	600	25	50	263	475	425	70
Py25/300B Soffit	300	25	0	75	150	150	>0

### Block Out: Minimum Element Thickness D 120mm

Disclaimer: All design rights reserved. Design and specifications are subject to change without notice. The manufacturer does not accept liability where the material on these pages is misconceived, exploited, or lacks conformity. The intention of this information is to provide a reasonable description of products, procedures and capabilities. Rev.7